



Data Sheet 4.22

Issue C



K5.6 (80) 15mm (1/2") Upright/ Pendant Sprinklers

Model: RD022/ RD023/ RD024/ RD025

Standard/Quick Response, 5mm/3mm Glass Bulbs

Product Description

RD022/ RD023/ RD024/ RD025 Upright/Pendant are Standard/Quick Response frangible glass bulb automatic sprinklers. They are CE marked, LPCB, FM and VdS approved, UL listed, standard orifice fire sprinklers for installation in fire sprinkler systems. Designed in accordance with standard installation rules, e.g. NFPA13, EN12845 or the requirements of the authority having jurisdiction.

Upright sprinklers produce a hemispherical water distribution pattern below the deflector. In a fire condition the heat causes the fluid in the glass bulb to expand which shatters the glass and releases the spring seal assembly. Water flows from the orifice onto the sprinkler deflector which diffuses the water into a uniform spray pattern which extinguishes or controls the fire.

Variations

Standard Response RD022 & RD024
 Quick Response RD023 & RD025



RD022 SSP



RD023 QR



RD024 SSU



RD025 SSU QR

Technical Details

K factor	K80 (K5.6)
Standard Orifice Size	15mm (1/2")
Thread size	1/2"NPT (R1/2" – 1/2"BSP T available on special order)
Max. Working Pressure	12 bar (175 psi)
Min. Operating Pressure	0.5 bar (7psi)
Factory Pressure Test	100% at 34 bar (500 psi)
Weight	57grams (2oz.)
Fitted with Bulb Protector	Remove after installing sprinkler

Operating Temperatures

Nominal Operating Temperature	Bulb Colour
57°C (135°F)	Orange
68°C (155°F)	Red
79°C (175°F)	Yellow
93°C (200°F)	Green
141°C (286°F)	Blue

Standard Finishes

- Plain (Natural)
- Chrome
- Epoxy Powder Polyester - White
(Other RAL colours available on special request)

Accessories

- Single Piece Escutcheon (Rosette)
- Adjustable Escutcheon (Rosette)
- Sprinkler Guard
- Series 20 Sprinkler Wrench



K5.6 (80) 15mm (1/2") Upright/ Pendant Sprinklers

Model: RD022/ RD023/ RD024/ RD025


Standard/Quick Response with 5mm/3mm Glass Bulbs

Design Coverage:

For sprinkler coverage area and placement refer to NFPA 13 standards or other Installation rules for automatic systems as required by the authority having jurisdiction. The following details are provided for information only.


RD022 & RD023

Spray Pendent for installing only in pendent position giving hemispherical discharge below the deflector with little or no water being discharged upwards.


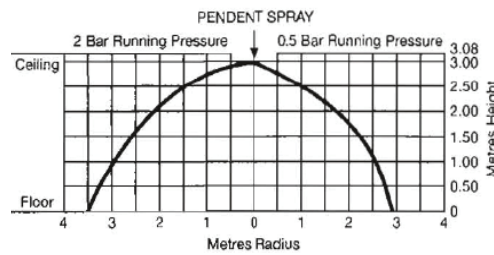


RD024 & RD025


Spray Upright for installing only in upright position giving hemispherical discharge below the deflector with little or no water being discharged upwards.

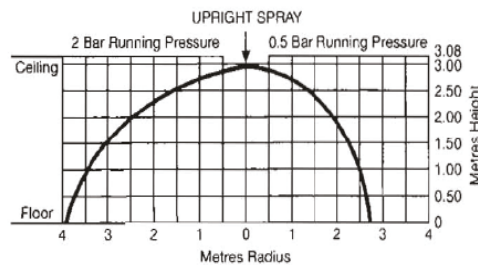

Minimum Operating Pressure = 7psig (0.5 Bars) Flow Characteristics

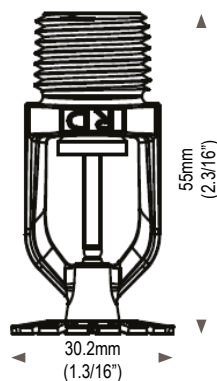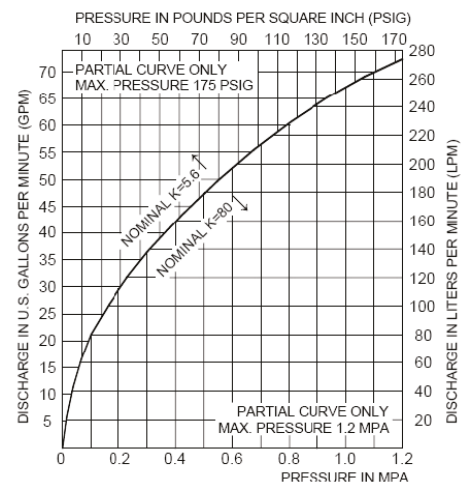

RD022 & RD023
SSP & QR SSP
Figure A

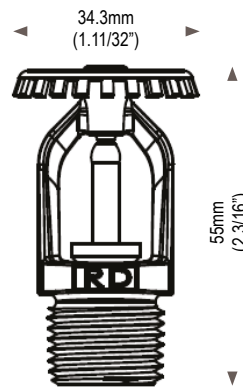

RD024 & RD025
SSU & QR SSU
Figure B

* Bulb sizes shown for reference only.



Data Sheet 4.22 Issue C



K5.6 (80) 15mm (1/2") Upright/ Pendant Sprinklers Model: RD022/ RD023/ RD024/ RD025 Standard/Quick Response with 5mm/3mm Glass Bulbs

Installation

1. All Rapidrop sprinklers must be installed and maintained in compliance with this document and according to the installation standards, EN 12845, or local rules and requirements which are specified by the authority having jurisdiction. It is the installer's responsibility to conform to such standards and requirements, deviations from the requirements will void any warranty.
2. To ensure that the minimum flow requirement is met, the system piping must be correctly sized.
3. To avoid mechanical damage the sprinklers must be installed after the piping is in place. Any damaged sprinklers must be replaced. If there is a leak from the sprinkler thread, remove the sprinkler, apply new pipe joint compound or tape and re-install.
4. Always check that the sprinklers are the correct model, style, orifice size, temperature and sensitivity ratings prior to commencing installation.
5. Upright sprinklers must be mounted in upright position and Pendent sprinklers must be mounted in pendent position.
6. Use only non-hardening pipe joint compound or 'Teflon' tape. Apply to external threads only.
7. Hand tighten the sprinkler into the fitting, then use the correct sprinkler wrench (Rapidrop Series 20 – See Figure C) to tighten the sprinkler into the fitting. Ensure that the sprinkler wrench stays on the wrench flats while tightening the sprinkler. A leak tight joint requires only 9.5 to 19 Nm (7 to 14 ft.lbs.) torque. i.e. A tangential force of 6.35 to 12.7kgs. (14 to 28 lbs.) delivered through a 150mm (6") handle will deliver adequate torque. Torque levels over 29Nm (21 ft.lbs.) may distort the orifice seal and result in leakage.
8. Remove sprinkler bulb protector before the sprinkler system is put into service.

Care and Maintenance

Sprinklers must be carefully handled and stored where temperatures will not exceed 100°F/38°C and they must never be painted, plated, coated or otherwise modified after leaving the factory.

Do not install sprinklers which have been dropped or damaged in any way.


The installation rules required by the authority having jurisdiction contain guidelines on minimum inspection and maintenance requirements to assist owners fulfilling their responsibility to ensure sprinklers and sprinkler systems are maintained in proper operating condition.

Warranty

Warranty period is one year from the date of shipment. For full details please refer to our terms and conditions of sale.

Ordering Information

Specify: model, orifice size, style, temperature, response, finish and a approval listing required. Always order and use a Series 20 Wrench for installing these sprinklers.

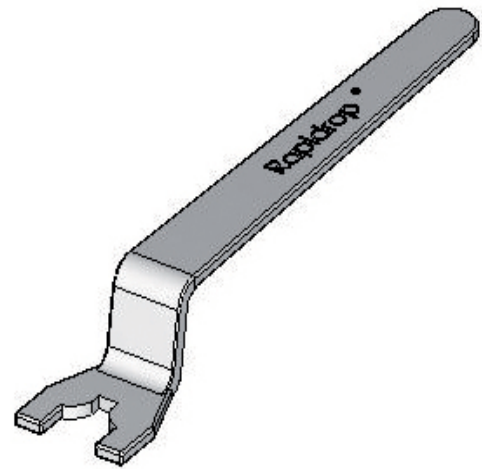

SERIES 20 WRENCH
Figure D



Data Sheet 4.51

Issue B




K115 (K8.0) Upright and Pendent Sprinklers

Models: RD042/ RD043/ RD044/ RD045

Standard and Quick Response 20mm (3/4" NPT)

Product Description


Rapidrop RD042/RD043 SSP and RD044/RD045 SSU are Standard/Quick Response frangible glass bulb automatic sprinklers. They are CE Marked, LPCB, VdS, FM approved, UL listed, standard orifice fire sprinklers for installation in fire sprinkler systems. Sprinklers produce a hemispherical water distribution pattern below the deflector. In a fire condition the heat causes the fluid in the glass bulb to expand which shatters the glass and releases the spring seal assembly. Water flows from the orifice onto the sprinkler deflector which diffuses the water into a uniform spray pattern which extinguishes or controls the fire.

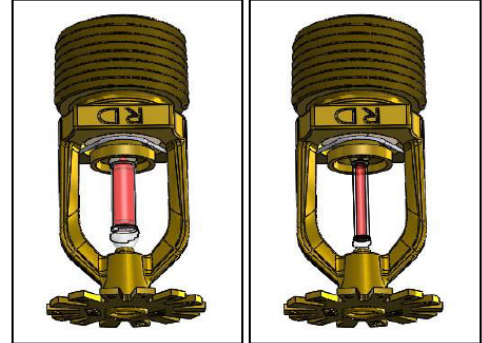

Standard Response

RD042 Pendent

RD044 Upright

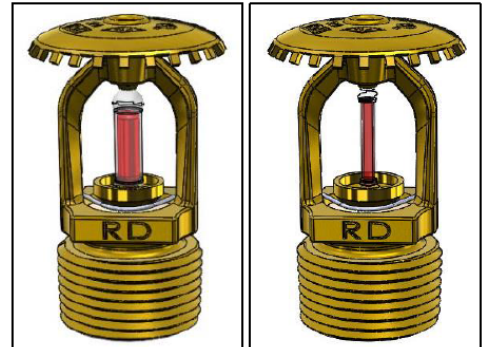

Quick Response

RD043 Pendent

RD045 Upright

Operating Temperatures

Nominal Operating Temperature	Bulb Colour
57°C (135°F)	Orange
68°C (155°F)	Red
79°C (175°F)	Yellow
93°C (200°F)	Green
141°C (286°F)	Blue

Standard Finishes

- Plain (Natural)
- Chrome
- White - Epoxy Powder Polyester
- Other RAL colours, available on request.

Technical Details

K factor	K115 (K8.0)
Thread size	3/4" NPT, R3/4 (3/4" BSPT) available on special order
Max. Working Pressure	12 bar (175 psi)
Min. Operating Pressure	0.5 bar (7psi)
Factory Pressure Test	34 bar (500 psi)
Weight	79 g (2.8 oz)
Fitted with Bulb Protector	Remove after installing sprinkler

Accessories

- Baffle plate
- Sprinkler Guard
- Sprinkler Wrench




K115 (K8.0) Upright and Pendent Sprinklers

Models: RD042/ RD043/ RD044/ RD045

Standard and Quick Response 20mm (3/4" NPT)

Design Coverage


For sprinkler coverage area and placement refer to NFPA 13 or EN 12845 standards or other Installation rules for automatic sprinkler systems as required by the authority having jurisdiction. The following details are provided for information only.

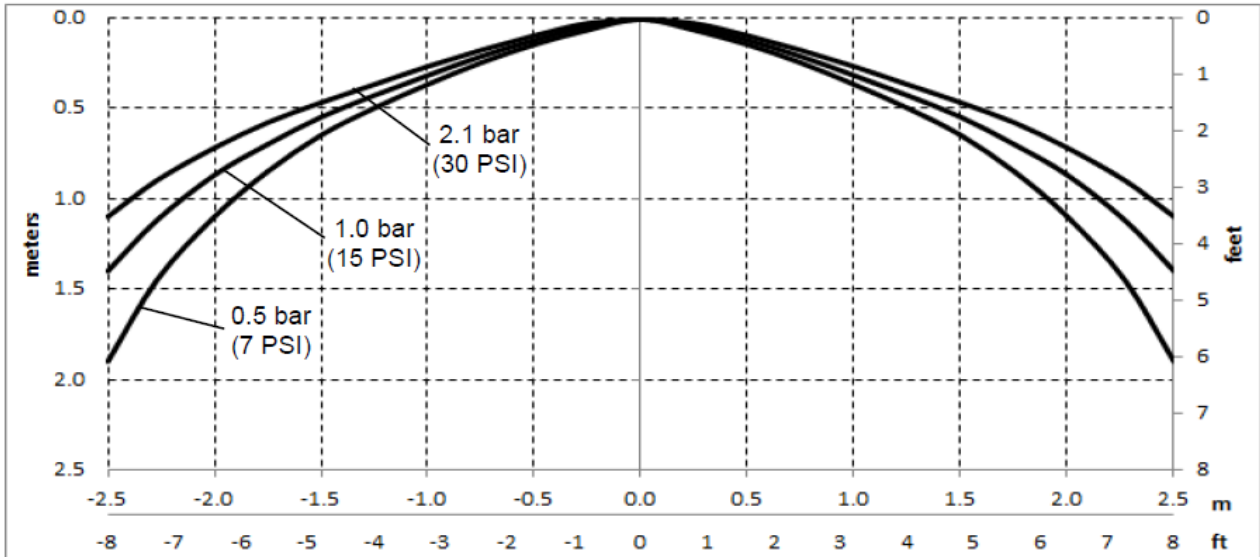

Rapidrop K115 (K8.0) Sprinkler Flow Characteristics



RD042, RD043

Spray Pendent Sprinkler
For installing only in pendent position giving hemispherical discharge below the deflector with little or no water being discharged upwards.

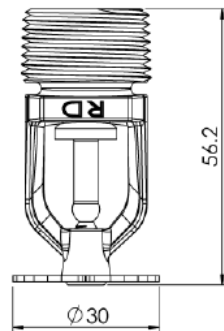

RD044, RD045

Spray Upright Sprinkler
For installing only in upright position giving hemispherical discharge below the deflector with little or no water being discharged upwards.

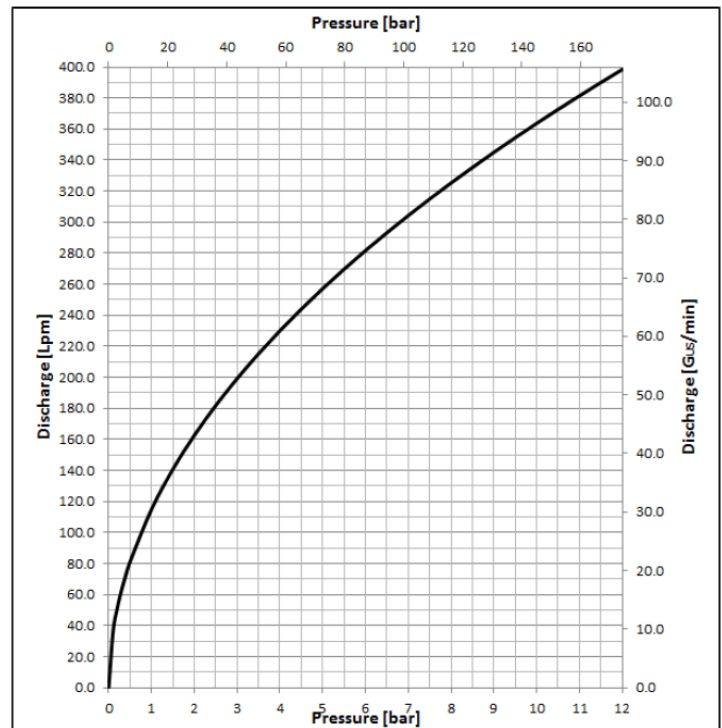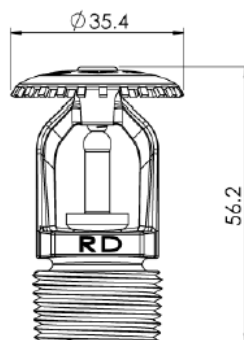



Data Sheet 4.51 Issue B



K115 (K8.0) Upright and Pendent Sprinklers Models: RD042/ RD043/ RD044/ RD045 Standard and Quick Response 20mm (3/4" NPT)

Installation

1. All Rapidrop sprinklers must be installed and maintained in compliance with this document and according to the installation standards, or local rules and requirements which are specified by the authority having jurisdiction. It is the installer's responsibility to conform to such standards and requirements, deviations from the requirements will void any warranty.
2. To ensure that the minimum flow requirement is met, the system piping must be correctly sized.
3. To avoid mechanical damage the sprinklers must be installed after the piping is in place. Any damaged sprinklers must be replaced. If there is a leak from the sprinkler thread, remove the sprinkler, apply new pipe joint compound or tape and re-install.
4. Always check that the sprinklers are the correct model, style, orifice size, temperature and sensitivity ratings prior to commencing installation.
5. Upright sprinklers must be mounted in upright position and Pendent sprinklers must be mounted in pendent position.
6. Use only non-hardening pipe joint compound or PTFE tape. Apply to external threads only.
7. Hand tighten the sprinkler into the fitting, then use the correct sprinkler wrench to tighten the sprinkler into the fitting. Ensure that the sprinkler wrench stays on the wrench flats while tightening the sprinkler. A leak tight joint requires only 10 to 19 Nm (7 to 14 ft.lbs.) torque. i.e. a tangential force of 6.35 to 12.7kgs. (14 to 28 lbs.) delivered through a 150mm (6") handle will deliver adequate torque. Torque levels over 29 Nm (21 ft.lbs.) may distort the orifice seal and result in a leakage.
8. Remove sprinkler bulb protector after the sprinkler is installed and before the system is put into service.

Care and Maintenance

Sprinklers must be carefully handled and stored where temperatures will not exceed 100°F/38°C and they must never be painted, plated, coated or otherwise modified after leaving the factory.

Do not install sprinklers which have been dropped or damaged in any way. The installation rules required by the authority having jurisdiction contain guidelines on minimum inspection and maintenance requirements to assist owners fulfilling their responsibility to ensure sprinklers and sprinkler systems are maintained in proper operating condition.

Warranty

Warranty period is one year from the date of shipment. For full details please refer to our terms and conditions of sale.

Ordering Information

Specify: model, orifice size, operating temperature, response type, finish and approval listing required.

Sprinkler Spanner



Always use Rapidrop sprinkler spanner for installing the sprinklers.
Part number: RDSPKSPANV2